




Application manual

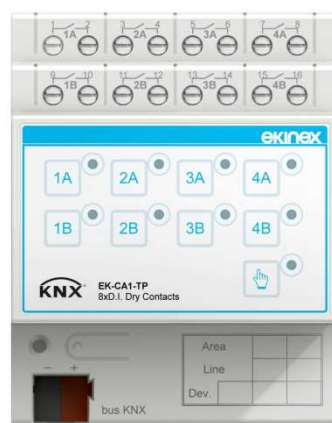

KNX 8-channel binary input module EK-CA1-TP

Contents

1	Scope of the document.....	4
2	Product description	5
3	Switching, display and connection elements	6
4	Configuration	7
5	Commissioning	7
6	Function description.....	8
6.1	Offline operation.....	8
6.2	Online operation.....	8
6.2.1	Software working cycle	8
6.2.2	Inputs.....	8
6.2.2.1	Input types.....	8
6.2.2.2	Input events.....	9
6.2.2.3	Lock function	10
6.2.3	State variables.....	10
6.2.3.1	State variables (Communication objects)	10
6.2.3.2	Binding between Events and Communication objects.....	11
6.2.3.3	Repeated send.....	11
6.2.4	Input coupling	11
6.2.4.1	Single input mode	11
6.2.4.2	Coupled Input mode.....	12
6.2.5	Manual operation	13
6.3	Device settings.....	14
6.3.1	General settings	14
6.3.2	Channels configuration	15
6.3.2.1	Independent: send values or sequences	16
6.3.2.2	Independent: dimming	16
6.3.2.3	Independent: shutter or venetian blind	17
6.3.2.4	Independent: scene	17
6.3.2.5	Independent: counter.....	18
6.3.2.6	Coupled: switch.....	18
6.3.2.7	Coupled: dimming	18
6.3.2.8	Coupled: shutter or venetian blind	18
6.3.3	Channel x: Input xA / xB configuration	20
6.3.3.1	Independent channels.....	20
6.3.3.2	Independent: Lock function enabled.....	21
6.3.3.3	Independent: send values or sequences	22
6.3.3.4	Independent: dimming	25
6.3.3.5	Independent: shutter or venetian blind	26
6.3.3.6	Independent: scene	27
6.3.3.7	Independent: counter.....	28
6.3.3.8	Coupled.....	29
6.3.3.9	Coupled: Lock function enabled.....	29

6.3.3.10	<i>Coupled: switch</i>	30
6.3.3.11	<i>Coupled: dimming</i>	31
6.3.3.12	<i>Coupled: shutter or venetian blind</i>	32
7	Appendix	33
7.1	Communication objects table.....	33
7.2	Warning.....	37
7.3	Other information	37

1 Scope of the document

This application manual describes application details for the A1.0 release of the ekinex® KNX binary input EK-CA1-TP (8 channels).

The document is aimed at the system configurator as a description and reference of device features and application programming. For installation, mechanical and electrical details of the device please refer to the technical description datasheet.

Application manual and application programs for ETS are available for download at www.ekinex.com.

Item	File name (## = release)	Version	Device rel.	Update
Technical datasheet	STEKCA1TP_EN.pdf	-	A1.0	02 / 2014
Application manual	MAEKCA1TP_EN.pdf	-		
Application program	APEKCA1TP##.knxprod	-		

You can access the most up-to-date version of the full documentation for the device using following QR code:



2 Product description

The ekinex® binary input EK-CA1-TP is an S-mode KNX modular device for rail mounting that allows to connect switches and sensors of conventional type (not communicating natively on the KNX bus), equipped with potential-free contacts, to the KNX bus.

Through the binary input module is possible to employ normal switches, pushbuttons and sensors or binary signals made available by other devices to switch and control KNX bus functions. The device can be used as follows:

- 8 independent single channels, e.g. for the connection of conventional switches or pushbuttons dedicated to the on/off switching of loads;
- 4 independent 2-input coupled channels, e.g. for the connection of conventional double pushbuttons for the control of dimmer or motorized drives.

The device is equipped with an integrated bus communication module and is designed for rail mounting in distribution boards.

The device basically receives an input signal and converts it into a corresponding telegram sent on the bus; the telegram sent by the device is received and processed by one or more KNX actuators.

The device is powered by the KNX bus line with a 30 VDC SELV voltage and does not require auxiliary power; all required operation voltages for the input channels are produced inside the device.




For further technical information, please also refer to the product datasheet STEKCA1TP_EN.pdf available on the ekinex website www.ekinex.com.

3 Switching, display and connection elements

The device is equipped with:

- a programming pushbutton and a programming LED
- membrane pushbuttons
- LEDs for input status indication
- terminals for connecting the inputs
- terminals for connecting the KNX bus line

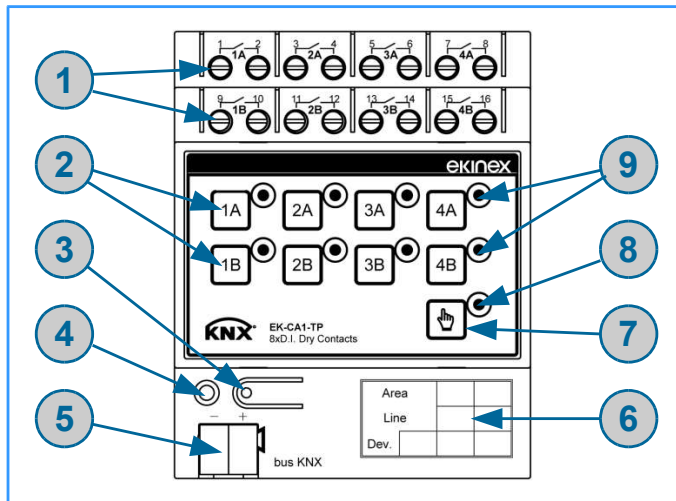

- 1) Terminal blocks for input channels
- 2) Pushbuttons for forced operation of the inputs
- 3) Programming pushbutton
- 4) Programming LED
- 5) Terminal block for KNX bus line
- 6) Field for physical address
- 7) Pushbutton for toggling manual / automatic mode
- 8) LED for indication manual / automatic mode
- 9) LEDs for status indication of input channels

Figure 1: Switching, display and connection elements

Input signals are normally taken from the terminal blocks; the switch devices to be connected must be capable of supplying a potential-free contact, either Normally Open or Normally Closed.

Voltage level signals (e.g. 24V signals) are not compatible with the device; a separation relay must be employed in case there is the need to interface such signals.

For convenience of operation, inputs can also be given manually by the user by means of the membrane buttons on the top panel. A pushbutton allows to switch to manual mode and back.

The status of all inputs (either from the terminal block or, in manual mode, from the buttons) is displayed through LEDs on the panel.

4 Configuration

The exact functionality of the device depends on the software settings.

In order to configure and commission the device you need ETS4 or later releases and the ekinex® application program APEKCA1TP.knxprod which can be downloaded from the ekinex website www.ekinex.com.

The application program allows the configuration of all working parameters for the device.

The device-specific application program has to be loaded into ETS or, as alternative, the whole ekinex® product database can be loaded; at this point, all the instances of the selected device type can be added to the project.

For every single device, ETS allows to set the operating parameters individually for each input as described in detail in the following chapters.

The configuration can, and usually will, be performed completely offline; the actual transfer of the programmed configuration to the device takes place in the commissioning phase.

Product code	EAN	No. of channels	ETS application software (## = release)	Communication objects (max nr.)	Group addresses (max nr.)
EK-CA1-TP	8018417180958	8	APEKCA1TP##.knxprod	156	254



Configuration and commissioning of KNX devices require specialized skills. To acquire these skills, you should attend training courses at a training center certified by KNX.

For further information: www.knx.org

5 Commissioning

After the device has been configured within the ETS project according to user requirements, the commissioning of the device requires the following activities:

- electrically connect the device, as described in the product datasheet, to the bus line on the final network or through a purposely setup network for programming;
- apply power to the bus;
- switch the device operation to programming mode by pressing the programming pushbutton located on the front side of the housing. In this mode of operation, the programming LED is turned on steady;
- upload the configuration (including the physical address) to the device with the ETS program.

At the end of the upload, the operation of the device automatically returns to normal mode; in this mode the programming LED is turned off. Now the device is programmed and ready for use on the bus.

6 Function description

After switching on the bus, which also acts as a power supply, the device becomes fully functional after a very short time needed for reinitialization. A delay is programmable for the device to become active on the bus in order to avoid a bus traffic overload during the first moments of startup of the whole network.

In case of a bus power failure (voltage lower than 19 V for 1 s or more), the device becomes unreactive: the timing functions are not active, neither are the programmed group addresses. As soon as the bus voltage is restored, the device will resume operation in its previous state (which is saved on power fail), unless different initialization settings are programmed.

6.1 Offline operation

A fully unprogrammed device causes no activity on the bus; it can be operated in manual mode so that the inputs are set as desired, but the input setting does not have effect on any other device.

6.2 Online operation

In general the device works like a configurable digital sensor that is listening to own inputs or outputs of other devices. On input events the device performs output functionality over KNX bus like sending values or controlling external devices like KNX actuators.

6.2.1 Software working cycle

The software working cycle can be described as follows:

- Handle input contacts or user pushbutton presses and generate bus telegrams according to the assigned functions;
- Implement input / pushbutton interlock and timing functions;
- Handle incoming bus messages in order to update the status of pushbutton activations and LED indicators;
- Respond to bus messages requesting feedback on the status of the inputs.

There are also special events on which it is possible to trigger additional features. These events are the bus failure and recovery, and the download of a new configuration with ETS.

6.2.2 Inputs

6.2.2.1 Input types

The status of digital inputs corresponds to the status of connected physical contacts.

The device may be configured in two modes, so as to be interfaced to different contacts: these modes are named **NO** (normally open) and **NC** (normally closed).

Usually, the mode denomination clearly matches the type of the contact of the electrical device used at the input. From a logical point of view, this mode affects the interpretation of the “active” and “inactive” state of an input as follows:

- In NO mode, an open connection between the terminals (open contact) is associated to the inactive state, while a closed contact is associated to the active state;
- in NC mode, an open connection between the terminals (open contact) is associated to the active state, while a closed contact is associated to the inactive state.

6.2.2.2 Input events

The device recognizes two types of input events: “close / open contact” and “short / long press”.

The first event type is a simple logical value change: “OPEN” is an alias for “inactive”, whereas “CLOSE” means “active state”.

It is very important to stress that the words “OPEN” and “CLOSE”, although standard terms for input status conditions, are to be interpreted from a logic point of view, and that they are not to be confused with the physical contact status as used in the description of “NO” and “NC” input types.

In other words, for example, a NO contact in active position is electrically AND logically CLOSED, whereas a NC contact in active position is electrically open, but logically CLOSED.


The second type of event that can be associated with an input is the Short or Long Press; the term “press” is typically referred to user activated pushbuttons, although it also applies to signals originating from contacts of other devices.

The distinction is as follows:

- If an input remains active for a period shorter than a defined time duration, upon release a “Short Press” event is generated;
- If the input remains active for longer than the defined time duration, at the duration time point a “Long Press” event is generated. Thereafter, the input can remain active for as long as desired, and no more events are generated either during the rest of activation or at release (next event will occur after next activation).

Please refer to time diagrams in following figures for an illustration of the difference between these events.

Time diagrams for normally open (NO) mode:

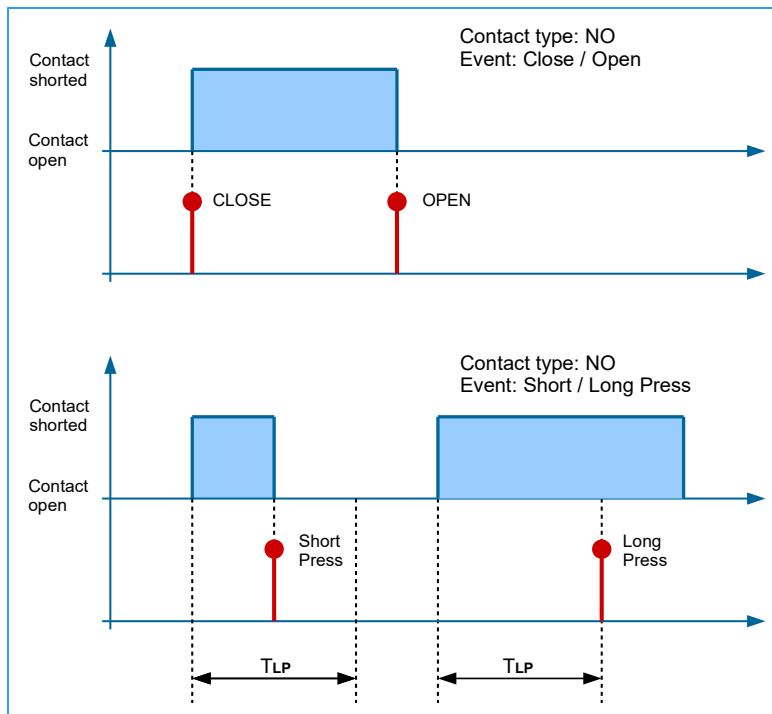

Time diagrams for normally close (NC) mode:

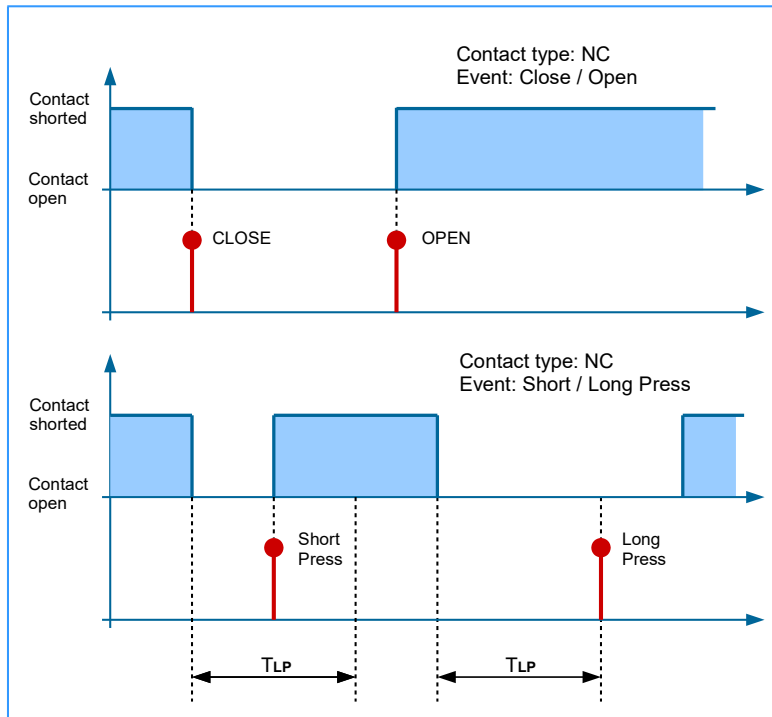


Figure 2: time diagrams for NO and NC modes

6.2.2.3 Lock function

For each input (or input pair if inputs are coupled, see below), a lock feature can be enabled which allows to block the operation of an input channel by changing a value of a communication object.

When in a locked state, the input / channel is effectively disabled; the locked state can be deactivated by sending another telegram.

A value (for each transition) can be specified to be assigned to the communication object upon entering or exiting the locked state.

The locked state can also be automatically activated when the bus is connected.

6.2.3 State variables

6.2.3.1 State variables (Communication objects)

The variables that are changed by the input events can be one of the types available for KNX communication objects, i.e. for instance a 1 bit value (on-off), a 2 bit value or an integer value of larger size.

In all cases, each of the two events can:

- change the value of the variable to one of two definable values within its range (which is trivial in the case of the 1-bit value);
- toggle between the two defined values
- do nothing (value is unaffected)

This state variable, once assigned a group address, is actually a **KNX communication object**; as such, it undergoes the usual rules for communication objects, among which – for instance – the effect of flags to determine how the change of value affects the transmission of the objects.

This obviously implies that, if the value of a communication objects changes due to the effect of a bus telegram, the corresponding change will register in the device, according to its associated flags.

6.2.3.2 *Binding between Events and Communication objects*

The above description is a little simplified in order to ease comprehension; as a matter of fact, to each event can be assigned not just one, but several communication objects (up to 8), even of different types. Each of these communication objects can have its own behavior and its own associated value set.

6.2.3.3 *Repeated send*

For most features, is it possible to set the device to send a telegram not just when a value changes as a consequence of an input transition, but also at regular intervals whenever that value setting is active.

This behavior, also referred to as Cyclical Transmission, can be set separately for each of the two values that are associated to an input (or both, or none of them).

If an input is set to “*send values or sequences*” mode, repeated send is not available if more than 1 Communication Object is assigned to that input.

6.2.4 **Input coupling**

The 8 inputs of the device can be considered, and used, as independent; however, due to the physical structure of the device and the nature of the functions it most frequently performs, these inputs can be naturally grouped in pairs. In this case, each channel is made of a pair of inputs which are physically close on the terminal block.

In order to maintain a consistent naming, the inputs are numbered in the same way regardless whether the channel pairing is used or not.

The coupled channels of the device are labelled 1 to 4, whereas the inputs are labelled 1A / 1B for channel 1, 2A / 2B for channel 2 and so on; for convenience, this same enumeration is used for labelling even if the inputs are used individually.

In order to specify channel pairings, each input can be configured in two ways: single mode and coupled mode.

- In *single mode*, each input operates independently, has its own parameters and communication objects. This is the mode of operation described so far.
- In *coupled mode*, 2 inputs operate logically grouped under the same channel in order to perform a common functionality. Only inputs belonging to the same channel can be coupled, therefore the only combinations allowed for coupling are 1A with 1B, 2A with 2B, and so on.

It is possible to configure some of the inputs in single mode and the others in coupled mode, with the pairing constraints just described.

Single and coupled modes have a similar functionality, but differ for the configuration.

6.2.4.1 *Single input mode*

Each single input can be configured for one of following different features:

1. *Send values or sequences*

An event triggers the transmission on the bus of configurable values or sequence of values. These values can be of a logical type or a numerical type with a different size.

A sequence of values can be made of up to 8 communication objects of different value types; time delays can set between values in the sequence.

2. Dimmer control

This mode is intended to be used with dimming actuators for the control of lighting devices.

The functionality is triggered on short press and long press events. On short press events, the device sends on/off telegrams to the dimming actuator; on long press events, the dimming percentage is varied up or down until the button is released.

3. Shutter or Venetian blind control

This mode is intended to be used together with actuators for the control of motorized blinds, shutters and similar devices. These actuators have functions for blind opening and closing; two movement types are selectable, i.e. continuous movement and stepwise movement. On input events, the device sends operation telegrams to the actuators.

The operation is configurable through following parameters:

- If *toggle* mode is enabled, on each activation of the same input the movement direction is inverted; if it is disabled, the movement direction is fixed and it can be set to “up” or “down”.
- If *blinds* mode is enabled, the device sends “full movement” telegrams on long press and “step” telegrams on short press; if it is disabled, the device sends “full movement” telegrams on long press and “stop” telegrams on short press.

4. Scene function output

This mode is intended to be used together with several KNX actuators that support using a scene function; this function allows to store and recall a communication object value on an actuator.

In this mode, the role of the device is to send a “store / recall scene” telegram to the actuator on a long / short press event.

This mode has two possible configurations:

- Activate preset scene on short press, and store current setting as scene value on long press
- Activate two different scenes on long and short press.

5. Pulse counter

In this mode the device can count the number of commutations at an input channel. The counter value can be read from a communication object which can be cyclically sent on specified time period. It is possible to set the counter's value type and maximum reachable value.

6.2.4.2 Coupled Input mode

Each pair of coupled inputs can be configured for one of following different features (only the differences from the single mode are highlighted):

1. Switch control

Both inputs in a pair are bound to the same communication object; unlike single mode, the object can only be of the 1-bit type (on-off), therefore building a conventional switching behaviour.

The user can configure which of the two inputs sets the “off” or resp. “on” value.

2. Dimmer control

The functionality is triggered on short press and long press events of the inputs in the pair.

The user can configure which of the two inputs sets the “up” or resp. “down” value.

On short press events, the input configured as “up” sends an “on” switching telegram to the dimming actuator, while the “down” input sends an “off” telegram.

On long press events, the dimming percentage is varied up or down until the button is released.

3. Shutter or Venetian blind control

The two inputs of a pair are assigned to opposite movement directions; these can be assigned to inputs as desired, i.e. A up / B down or the other way around.

The *blinds* mode can also be set, and it works exactly as in single mode.

In coupled mode there is no provision either for a *scene* control feature or for a *counter* feature.

6.2.5 Manual operation

The manual operation works as an alternative to the physical inputs. When the manual operation is activated, any signal changes coming from the physical inputs will be not considered, and the device can only be operated via the membrane pushbuttons on the front side of the device. If group addresses have been assigned, telegrams will be sent on the bus. It is possible to control a channel through the membrane keypad. Each pushbutton press sends a telegram like they were acquired physically. The LED of each pushbutton shows if the contact is closed.

For switching the device to the manual operations mode proceed according to the following steps:


- 1) Press the manual mode pushbutton. In normal operation the LED is turned off. When the LED turns on, the whole membrane keypad is activated and the manual operations are allowed.



- 2) Press the pushbutton of the keypad corresponding to the channel that has to be operated (in the example: 1A).



- 3) After the operation, turn off the manual mode by pressing again the manual mode pushbutton. After switching off manual operations the input value will be accorded to the physical input.

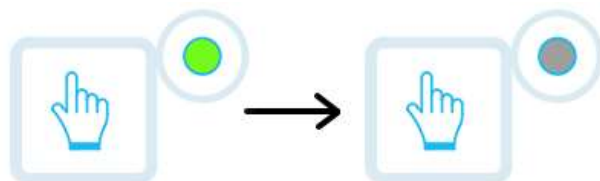

6.3 Device settings

This section lists all configurable parameters and describes related communication objects.

Every channel, and every input or input pair under a channel, offers the same set of communication objects and parameters, but they may all be independently configured.

Hereafter, all channel-specific settings are listed grouped by channel; a generic channel number is referenced as “x” (where x = 1...4), while a generic input is referenced as “xx” (xx = 1A, 1B, 2A, ... 4B).



The parameter values highlighted in bold represent the default value.

The device settings are divided in two main groups: the *general* settings and the *channel-specific* settings.

6.3.1 General settings

The parameters in this section define the overall behavior of the device.

Parameter name	Conditions	Settings
Manual operations	-	enabled / disabled
	<i>This parameter enables or disables the membrane keypad of the device. If it is set to “enabled”, the manual operations mode is available and can be recalled pressing the corresponding pushbutton of the membrane keypad. If it is set to “disabled”, the manual operations mode is unavailable.</i>	
Disable from bus	Manual operations = enabled	yes / no
	<i>Enables or disables the capability of disabling manual operation of the inputs through a remote command (telegram).</i>	
Restore auto mode	Manual operations = enabled Disable from bus = no	hh:mm:ss (00:15:00)
	<i>Allows to automatically switch off the manual operations mode after a time interval, in order to prevent the device to be unintentionally left offline . The value 00:00:00 (zero) means that there is no automatic restore.</i>	
Debounce time	-	hh:mm:ss.fff (00:00:00.020)
	<i>Sets a minimum time during which an input must remain stable in order to be considered valid, in order to avoid contact bounces or spikes .</i>	
Delay after bus voltage recovery	-	hh:mm:ss.fff (00:00:04.000)
	<i>Delay before bus telegrams can be sent after a recovery of the bus voltage. The delay time affects the transmission generated by an event as well as the cyclical transmission. For the cyclical transmission: after the delay time finished, the cycle restarts and the first telegram will be sent after the cycle time.</i>	

Object name	Conditions	Size	Flags	DPT	CO number(s)
Disable front pushbuttons	-	1 bit	C-W--	[1.002] false / true	0

6.3.2 Channels configuration

These settings configure device channel behavior.

Parameter name	Conditions	Settings
Channel x	-	disabled independent coupled copy parameters from channel*
<p>Set operation mode for inputs corresponding to Channel x.</p> <p>* This option is only available for channels nr. 2 and above. If selected, the corresponding channel can be made to perform the exact same kind of function as another specified channel, but <u>basing on different communication objects</u>.</p> <p>This allows to spare time in configuring the device, at the same time assuring that there is no inconsistency between two channels that are meant to be configured in exactly the same way.</p> <p>To assign the same configuration is just a shortcut for the selection of configuration options; it is in no way implied that the two channels share any of the involved communication objects (each channel has its own independent objects).</p>		
Input xA	Channel x = independent	enabled / disabled
Enables or disables the capability to generate events for the specified individual input.		
Type	Channel x = independent Input xA = enabled	send values or sequences dimming shutter or venetian blind scene counter
<p>Determines the kind of function performed by the specified input.</p> <p>Further parameters for the selected function will appear in the individual input configuration sections (see below).</p>		
Input xB	Channel x = independent	disabled enabled copy parameters from input xA
<p>Enables or disables the capability to generate events for the specified input.</p> <p>If not disabled, the input can be given an own independent function (enabled), or perform the exact same kind of function as first input (copy parameters), but possibly <u>basing on a different communication object</u>.</p>		
Type	Channel x = independent Input xB = enabled	send values or sequences dimming shutter or venetian blind scene counter
<p>Determines the kind of function performed by the specified input.</p> <p>Further parameters for the selected function will appear in the individual input configuration sections (see below).</p>		
Type	Channel x = coupled	switch dimming shutter or venetian blind
<p>Determines the kind of function performed by the input pair.</p> <p>Further parameters for the selected function will appear in the individual rocker configuration sections (see below).</p>		

Parameter name	Conditions	Settings
Channel to copy from	Channel x = copy parameters from channel (x > 1)	1..(x-1)*
<p>All the parameters of the destination channel (X) are copied from the chosen source channel.</p> <p>* The values that can be chosen are those lower than the number of the channel for which the selection is made.</p>		

6.3.2.1 Independent: send values or sequences

Object name	Conditions	Size	Flags	DPT	CO number(s)
Input xx – Switching status [type], object n	Channel x = independent Input xx = enabled Type = send values or sequences	According to configuration (1-bit)	CRWTU	According to configuration ([1.001] switch)	5, 22 (1A, 1B) 43, 60 (2A, 2B) 81, 98 (3A, 3B) 119, 136 (4A, 4B)
<p>Up to 8 objects can be defined for binding with the same event.</p> <p>The listed CO numbers are those referring to object nr.1; the COs for each subsequent object are following in sequence.</p> <p>To obtain the CO numbers for object number n, just add (n-1) to the listed numbers.</p> <p>E.g.: COs associated to input 3A (of Channel 3) have numbers from 81 to 89. The number of CO nr. 5 is therefore 81+(5-1) = 85.</p> <p>The size and type of the individual objects can be configured as described in following sections.</p>					

6.3.2.2 Independent: dimming

Object name	Conditions	Size	Flags	DPT	CO number(s)
Channel x – Switching command	Channel x = independent Input xx = enabled Type = dimming	1 bit	CR-T-	[1.001] switch	13, 30 (1A, 1B) 51, 68 (2A, 2B) 89, 106 (3A, 3B) 127, 144 (4A, 4B)
<p>Send a command to a dimming actuator to switch the light on or off.</p> <p>The command is triggered by a short press on the input.</p> <p>The value sent can be a fixed value or it can be toggled at each input activation.</p>					
Channel x – Dimming up / down / stop command	Channel x = independent Input xx = enabled Type = dimming	4 bit	CR-T-	[3.*] 3-bit control	14, 31 (1A, 1B) 52, 69 (2A, 2B) 90, 107 (3A, 3B) 128, 145 (4A, 4B)
<p>Send a command to a dimming actuator to change dimming intensity (brighter or darker).</p> <p>Three values are used which mean start increase, start decrease or stop the change.</p> <div style="text-align: center;"> <p>Increase Decrease</p> <p>1 0 0 0 0 0 0 1</p> <p>Stop dimming</p> <p>0 0 0 0</p> </div> <p>Increase/decrease values are sent when a long press action occurs and stop value on press release.</p> <p>The value sent can be a fixed value or it can be toggled at each input activation.</p>					

6.3.2.3 Independent: shutter or venetian blind

Object name	Conditions	Size	Flags	DPT	CO number(s)
Input xx – Dedicated stop command	Channel x = independent Input xx = enabled Type = shutter or venetian blind	1 bit	CR-T-	[1.017] trigger	13,30 (1A, 1B) 51,68 (2A, 2B) 89,106 (3A, 3B) 127,144 (4A, 4B)
<i>Immediately stop any movement of the blind. The object is sent on a short press if the blind mode is disabled, and at the end of a long press if the venetian blind mode is enabled.</i>					
Input xx – Stop – step up/down command	Channel x = independent Input xx = enabled Type = shutter or venetian blind Blind mode = enabled	1 bit	CR-T-	[1.007] step	16,33 (1A, 1B) 54,71 (2A, 2B) 92,109 (3A, 3B) 130,147 (4A, 4B)
<i>Move the blind to fully open or fully closed position. The object is sent at the end of a long press.</i>					
Input xx – Move up / down command	Channel x = independent Input xx = enabled Type = shutter or venetian blind	1 bit	CR-T-	[1.008] up/down	17,34 (1A, 1B) 55,72 (2A, 2B) 93,110 (3A, 3B) 131,148 (4A, 4B)
<i>Increase or decrease the opening of the blind stepwise. The object is sent on a short press.</i>					

6.3.2.4 Independent: scene

Object name	Conditions	Size	Flags	DPT	CO number(s)								
Input xx – Scene number	Channel x = independent Input xx = enabled Type = scene	1 Byte	CR-T-	[17.*] Scene number [18.*] Scene control	18,35 (1A, 1B) 61,73 (2A, 2B) 94,111 (3A, 3B) 132,149 (4A, 4B)								
<p>Store or recall a scene. The lowest 6 bits in the byte form the code of the scene, while the highest bit is the operation code (store or recall).</p> <p style="text-align: center;">1 Byte</p> <div style="text-align: center;"><p>Bit number</p><table border="1" style="margin: auto;"><tr><td>7</td><td>6</td><td>5</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td></tr></table><div style="margin-top: 10px;"><div style="border: 1px solid black; width: 150px; height: 15px; margin: 0 auto; position: relative;"><div style="position: absolute; top: -5px; left: 50px;">scene number (1-64)</div></div><div style="margin-top: 10px;"><div style="border: 1px solid black; width: 100px; height: 15px; margin: 0 auto; position: relative;"><div style="position: absolute; top: -5px; left: 50px;">not used</div></div></div><div style="margin-top: 10px;"><div style="border: 1px solid black; width: 100px; height: 15px; margin: 0 auto; position: relative;"><div style="position: absolute; top: -5px; left: 50px;">0 = recall , 1 = save</div></div></div></div></div>						7	6	5	4	3	2	1	0
7	6	5	4	3	2	1	0						

6.3.2.5 Independent: counter

Object name	Conditions	Size	Flags	DPT	CO number(s)
Input xx – Counter value	Channel x = independent Input xx = enabled Type = counter	According to configuration (1-bit)	CR-T-	[12.001] Counter pulses [13.001] Counter pulses	18, 35 (1A, 1B) 61, 73 (2A, 2B) 94, 111 (3A, 3B) 132, 149 (4A, 4B)
This object stores the current value of the input counter					
Input xx – Counter reset command	Channel x = independent Input xx = enabled Type = counter	1-bit	C-W--	[1.015] reset	19, 36 (1A, 1B) 62, 74 (2A, 2B) 95, 112 (3A, 3B) 133, 150 (4A, 4B)
Reset the counter by setting its value to zero					
Input xx – Counter runout	Channel x = independent Input xx = enabled Type = counter	1-bit	CR-T-	[1.055] alarm	20, 37 (1A, 1B) 63, 75 (2A, 2B) 96, 113 (3A, 3B) 134, 151 (4A, 4B)
Send an alarm bit when the counter reaches the maximum value according to the data size defined for the counter.					

6.3.2.6 Coupled: switch

Object name	Conditions	Size	Flags	DPT	CO number(s)
Channel x – Switching command	Channel x = coupled Input xx = enabled Type = switch	1-bit	CRWTU	[1.001] switch	13 51 89 127

6.3.2.7 Coupled: dimming

Object name	Conditions	Size	Flags	DPT	CO number(s)
Channel x – Switching command	Channel x = coupled Input xx = enabled Type = dimming	1 bit	CRWTU	[1.001] switch	13 51 89 127
For notes, see the equivalent section for independent inputs.					
Channel x - Dimming up / down / stop command	Channel x = independent Input xx = enabled Type = dimming	4 bit	CR-T-	[3.*] 3-bit control	14 52 90 128
For notes, see the equivalent section for independent inputs.					

6.3.2.8 Coupled: shutter or venetian blind

Object name	Conditions	Size	Flags	DPT	CO number(s)
Channel x – Dedicated stop command	Channel x = coupled Input xx = enabled Type = shutter or venetian blind Blind mode = disabled	1 bit	CRWTU	[1.017] trigger	13 51 89 127
For notes, see the equivalent section for independent inputs.					

Object name	Conditions	Size	Flags	DPT	CO number(s)
Channel x – Stop – step up/down command	Channel x = coupled	1 bit	CR-T-	[1.007] step	16
	Input xx = enabled				54
	Type = shutter or venetian blind				92
	Blind mode = enabled				130
For notes, see the equivalent section for independent inputs.					
Channel x – Move up / down command	Channel x = coupled	1 bit	CRWTU	[1.008] up/down	17
	Input xx = enabled				55
	Type = shutter or venetian blind				93
					131
For notes, see the equivalent section for independent inputs.					

6.3.3 Channel x: Input xA / xB configuration

6.3.3.1 Independent channels

For the *independent* or single channel setting, all parameters listed below are referred to either Input A or Input B (whichever are enabled).

In the following sections, it is implicitly understood that for the listed parameters to appear, the corresponding inputs xA and/or xB must be enabled.

The entries assigned to “Object *n*” are repeated so many times as the number of configured objects according to the *Number of Communication Objects* parameter.

For all Type values:

Parameter name	Conditions	Settings
Contact type	-	NO (normally open) NC (normally closed)
	<i>In normally open (NO) mode the “active” state of the input is when input contacts shorted, and the “inactive” state is when they are disconnected. In normally closed (NC) mode the device behaviour is the opposite.</i>	
Lock function	-	enabled / disabled
	<i>Enables or disables the capability of locking the input through a remote command (telegram).</i>	
Lock function – Invert lock device	Channel x = independent Type = send values or sequences	not inverted / inverted
	<i>Allows to interpret a “lock activate” telegram as unlock and vice-versa.</i>	
Lock function – Lock after bus recovery	Channel x = independent Type = send values or sequences	no / yes
	<i>If active, after returning from a bus failure or power-off the device will retain the lock status it had before. Otherwise (in the default case), the device will restart in the non-locked condition.</i>	

6.3.3.2 Independent: Lock function enabled

Object name	Conditions	Size	Flags	DPT	CO number(s)
Input xx – Lock command	Channel x = independent Lock function = enabled	1 bit	C-W--	[1.003] enable	4,21 (1A, 1B) 42,59 (2A, 2B) 80,97 (3A, 3B) 118,135 (4A, 4B)

When the lock function is enabled, for each input or channel a behaviour can be defined to be followed when the locking or unlocking command is received.

The details will be listed in the following sections; the different behaviours are summarized in the table below.

Channel mode	Input type	Behaviour at locking	Behaviour at unlocking
independent	send values or sequences	none as close or short press as open or long press	
	switching	none off on toggle	none off on as previous
coupled			
independent	dimming		
coupled			
independent	scene	none send first scene send second scene	
independent	shutter or venetian blind	none up down	
coupled			
independent	counter	none send counter value	

6.3.3.3 Independent: send values or sequences

Parameter name	Conditions	Settings
Number of Communication Objects	Channel x = independent Type = send values or sequences	1...8 (1)
<i>Number of configuration objects configured in association with the input event.</i>		
Lock function – Behaviour at locking	Channel x = independent Type = send values or sequences	none as close or short press as open or long press
<i>Allows to perform the operation associated to the specified event when a locking command is received.</i>		
Lock function – Behaviour at unlocking	Channel x = independent Type = send values or sequences	none as close or short press as open or long press
<i>Allows to perform the operation associated to the specified event when an unlocking command is received.</i>		
Event	Channel x = independent Type = send values or sequences	close / open contact short / long press
<i>Type of event that should be used as trigger for an action</i>		
Long press time	Channel x = independent Type = send values or sequences Event = short /long press	hh:mm:ss.fff (00:00:03.000)
<i>Minimum push time for a press in order to be recognized as a long press.</i>		
Object n – send delay	Channel x = independent Type = send values or sequences	hh:mm:ss.ff (00:00:00.00)
<i>Delay before the object is transmitted on the bus. By defining a delay after the event occurs and before the object value is sent, it is possible to associate a time defined sequence of values to an input event.</i>		
Object n – Cyclical transmission	Channel x = independent Type = send values or sequences Number of Comm. Objects = 1	none off / value 1 on / value 2 both off and on / both values
<i>Defines which of the values, if any, must be cyclically retransmitted whenever activated. Cyclical transmission is only available if the number of Communication Objects is set to "1".</i>		
Object n – Cyclical transmission interval	Channel x = independent Type = send values or sequences Number of Comm. Objects = 1 Send cyclically ≠ none	hh:mm:ss (00:02:00)
<i>Interval between cyclical transmissions.</i>		
Object n – Communication Object dimension	Channel x = independent Type = send values or sequences	1 bit value 2 bits value 1 byte unsigned value 1 byte percentage 1 byte signed value 2 bytes unsigned value 2 bytes signed value 2 bytes floating point value
<i>Defines size and type of the values to be sent when an event occurs.</i>		

Parameter name	Conditions	Settings
Object <i>n</i> – Close or Short Press	Channel <i>x</i> = independent Type = send values or sequences send dimension = 1 bit value	none on off toggle
	Channel <i>x</i> = independent Type = send values or sequences send dimension = 2 bit value	none disable enable off / up enable on / down enable off / up ↔ disable enable on / down ↔ disable enable off / up ↔ enable on / down
	Channel <i>x</i> = independent Type = send values or sequences send dimension = any byte value	none send value 1 send value 2 send value 1 ↔ send value 2
<i>Value change behaviour caused by either a Close or a Short Press event (according to event configuration)</i>		
Object <i>n</i> – Open or Long Press	Channel <i>x</i> = independent Type = send values or sequences send dimension = 1 bit value	none on off toggle
	Channel <i>x</i> = independent Type = send values or sequences send dimension = 2 bit value	none disable enable off / up enable on / down enable off / up ↔ disable enable on / down ↔ disable enable off / up ↔ enable on / down
	Channel <i>x</i> = independent Type = send values or sequences send dimension = any byte value	none send value 1 send value 2 send value 1 ↔ send value 2
<i>Value change behaviour caused by either an Open or a Long Press event (according to event configuration)</i>		
Object <i>n</i> – Value 1	Channel <i>x</i> = independent Type = send values or sequences send dimension = any byte value	0...255 (1 byte unsigned value) 0...100 (1 byte percentage) -128...127 (1 byte signed value) 0...65535 (2 bytes unsigned value) -32768... 32767 (2 bytes signed value) -671088.64...670760.96 (2 bytes floating value)
<i>First value available for association in send events</i>		
Object <i>n</i> - Value 2	Channel <i>x</i> = independent Type = send values or sequences send dimension = any byte value	<i>same as value 1</i>
<i>Second value available for association in send events</i>		
Object <i>n</i> - Value sent after bus on	Channel <i>x</i> = independent Type = send values or sequences send dimension = 1 bit value	none on off previous

Parameter name	Conditions	Settings
	Channel x = independent Type = send values or sequences send dimension = 2 bit value	none disable enable off / up enable on / down previous
	Channel x = independent Type = send values or sequences send dimension = any byte value	none send value 1 send value 2 previous
Value to be sent after a recovery of the bus voltage.		

Object name	Conditions	Size	Flags	DPT	CO number(s)
Input xx – Switching status [type] Object n	Channel x = independent Type = send values or sequences	See table below	CRWTU	See table below	5, 22 (1A, 1B) 43, 60 (2A, 2B) 81, 98 (3A, 3B) 119, 136 (4A, 4B)
<p>The listed CO numbers are those referring to object nr.1; the COs for each subsequent object are following in sequence.</p> <p>To obtain the CO numbers for object number n, just add (n-1) to the listed numbers.</p> <p>E.g.: COs associated to input 3A (of Channel 3) have numbers from 81 to 89. The number of CO nr. 5 is therefore 81+(5-1) = 85.</p>					

Sizes and DPTs are as follows:

Size	DPT
1 bit	[1.001] switch
2 bits	[2.*] 1-bit controlled
1 byte unsigned	[4.*] character [5.*] 8-bit unsigned value [20.*] 1-byte
1 byte percentage	[4.*] character [5.*] 8-bit unsigned value [20.*] 1-byte
1 byte signed	[6.*] 8-bit signed value
2 bytes unsigned	[7.*] 2-byte unsigned value
2 bytes signed	[8.*] 2-byte signed value
2 bytes floating	[9.*] 2-byte float value

6.3.3.4 Independent: dimming

Parameter name	Conditions	Settings
Long press time	Channel x = independent Type = dimming	hh:mm:ss.fff (00:00:03.000)
<i>Minimum push time for a press in order to be recognized as a long press.</i>		
Toggle mode	Channel x = independent Type = dimming	enabled / disabled
<i>When enabled, causes the short press to toggle the on-off status of the destination CO; otherwise, a fixed status can be assigned to the short press.</i>		
Long press	Channel x = independent Type = dimming Toggle mode = enabled	darker brighter darker ↔ brighter
<i>Defines the function to be assigned to the long press. If the toggle mode is enabled, the Short press action is already defined as toggle.</i>		
Short / Long action	Channel x = independent Type = dimming Toggle mode = disabled	off / darker on / brighter off / darker ↔ brighter on / darker ↔ brighter
<i>Defines the function to be assigned to the long and short press.</i>		
Cyclical transmission	Channel x = independent Type = dimming	none off / value 1 on / value 2 both off and on / both values
<i>Defines which of the values, if any, must be cyclically retransmitted whenever activated.</i>		
Cyclical transmission interval	Channel x = independent Type = dimming Send cyclically ≠ none	hh:mm:ss (00:02:00)
<i>Interval between cyclical transmissions.</i>		
Lock function – Behaviour at unlocking	Channel x = independent Type = dimming	none off on as previous
<i>Operation to perform when an unlocking command is received.</i>		
Lock function – Behaviour at locking	Channel x = independent Type = dimming	none off on toggle
<i>Operation to perform when a locking command is received.</i>		
Value sent after bus on	Channel x = independent Type = dimming	none off on previous
<i>Value to be sent after a recovery of the bus voltage.</i>		

6.3.3.5 Independent: shutter or venetian blind

Parameter name	Conditions	Settings
Long press time	Channel x = independent Type = shutter or venetian blind	hh:mm:ss.fff (00:00:03.000)
<i>Minimum push time for a press in order to be recognized as a long press.</i>		
Toggle mode	Channel x = independent Type = shutter or venetian blind	enabled / disabled
<i>When enabled, causes each subsequent press to invert the direction of movement; otherwise, a fixed direction can be assigned.</i>		
Up / Down action	Channel x = independent Type = shutter or venetian blind Toggle mode = disabled	up down
<i>Defines the movement direction to be assigned to the button press.</i>		
Venetian blind mode	Channel x = independent Type = shutter or venetian blind	enabled / disabled
<i>If blinds mode is enabled, the device sends "full movement" telegrams on long press and "step" telegrams on short press; if it is disabled, the device sends "full movement" telegrams on long press and "stop" telegrams on short press.</i>		
Lock function – Behaviour at locking	Channel x = independent Type = shutter or venetian blind	none up down
<i>Allows to perform the specified operation when a locking command is received.</i>		
Lock function – Behaviour at unlocking	Channel x = independent Type = shutter or venetian blind	none up down
<i>Allows to perform the specified operation when an unlocking command is received.</i>		
Value sent after bus on	Channel x = independent Type = shutter or venetian blind	none up down
<i>Value to be sent after a recovery of the bus voltage.</i>		

6.3.3.6 Independent: scene

Parameter name	Conditions	Settings
First scene number	Channel x = independent Type = scene	1...64 (1)
	Main scene number to be assigned to button press. It is named "first" for the case that an alternative scene number is used.	
Learning mode	Channel x = independent Type = scene	enabled / disabled
	When enabled, a long key press can be used to program the selected scene by storing the current parameters.	
Long press time	Channel x = independent Type = scene Learning mode = enabled	hh:mm:ss.fff (00:00:03.000)
	Minimum push time for a press in order to be recognized as a long press.	
Scene activation	Channel x = independent Type = scene Learning mode = disabled	send first scene only toggle between two scenes
	Allows the key to be used to alternate between two different scenes.	
Second scene number	Channel x = independent Type = scene Learning mode = disabled Scene activation = toggle between two scenes	1...64 (2)
	Alternate scene number to be assigned to button press.	
Lock function – Behaviour at locking	Channel x = independent Type = scene	none send first scene send second scene
	Operation to perform when a locking command is received.	
Lock function – Behaviour at unlocking	Channel x = independent Type = scene	none send first scene send second scene
	Operation to perform when an unlocking command is received.	
Value sent after bus on	Channel x = independent Type = scene Scene activation = send first scene only	none first scene
	Channel x = independent Type = scene Scene activation = toggle between two scenes	none first scene second scene last
	Value to be sent after a recovery of the bus voltage.	

6.3.3.7 Independent: counter

Parameter name	Conditions	Settings
Cyclical transmission interval	Channel x = independent Type = counter	hh:mm:ss (00:02:00)
<i>Interval between cyclical transmissions. A zero value (00:00:00) means no cyclical transmission.</i>		
Counter dimension	Channel x = independent Type = counter	from 0 to 255 (1 byte) from 0 to 65535 (2 bytes) from 0 to 4294967295 (4 bytes)
<i>Value type of the counter. Unsigned integer value of 1, 2 or 4 bytes.</i>		
Max value	Channel x = independent Type = counter	Depending on the counter dimension: 0... 255 0... 65535 0... 4294967295 (default value is the maximum value of the selected interval)
<i>Limit value for the counter. When this value is reached, a "runout" telegram is sent and the counter value is reset to zero.</i>		

6.3.3.8 Coupled

For a *coupled* channel, all the parameters are referred to the single menu entry for Input xA and xB.

In the following sections, it is implicitly understood that for the listed parameters to appear, the corresponding inputs xA and xB must be enabled.

For all Type values:

Parameter name	Conditions	Settings
Lock function	Channel x = coupled	enabled / disabled
<i>Enables or disables the capability of locking the input through a remote command (telegram).</i>		

6.3.3.9 Coupled: Lock function enabled

Object name	Conditions	Size	Flags	DPT	CO number(s)
Channel x – Lock command	Channel x = coupled Lock function = enabled	1 bit	C-W--	[1.003] enable	4
					42
					80
					118

6.3.3.10 Coupled: switch

Parameter name	Conditions	Settings
xA and xB use	Channel x = coupled Type = switch	A on, B off A off, B on
Cyclical transmission	Channel x = coupled Type = switch	none off / value 1 on / value 2 both off and on / both values
<i>Defines which of the values, if any, must be cyclically retransmitted whenever activated.</i>		
Cyclical transmission interval	Channel x = coupled Type = switch Send cyclically ≠ none	hh:mm:ss (00:02:00)
<i>Interval between cyclical transmissions.</i>		
Lock function – Behaviour at locking	Channel x = coupled Type = switch	none off on toggle
<i>Operation to perform when a locking command is received.</i>		
Lock function – Behaviour at unlocking	Channel x = coupled Type = switch	none off on previous
<i>Operation to perform when an unlocking command is received.</i>		
Value sent after bus on	Channel x = coupled Type = switch	none off on previous
<i>Value to be sent after a recovery of the bus voltage.</i>		

6.3.3.11 Coupled: dimming

Parameter name	Conditions	Settings
Long press time	Channel x = coupled Type = dimming	hh:mm:ss.fff (00:00:03.000)
<i>Minimum push time for a press in order to be recognized as a long press.</i>		
xA and xB use	Channel x = coupled Type = dimming	A increases, B decreases A decreases, B increases
Cyclical transmission	Channel x = coupled Type = dimming	none off / value 1 on / value 2 both off and on / both values
<i>Defines which of the values, if any, must be cyclically retransmitted whenever activated.</i>		
Cyclical transmission interval	Channel x = coupled Type = dimming Send cyclically ≠ none	hh:mm:ss (00:02:00)
<i>Interval between cyclical transmissions.</i>		
Lock function – Behaviour at locking	Channel x = coupled Type = dimming	none off on toggle
<i>Operation to perform when a locking command is received.</i>		
Lock function – Behaviour at unlocking	Channel x = coupled Type = dimming	none off on toggle
<i>Operation to perform when an unlocking command is received.</i>		
Value sent after bus on	Channel x = coupled Type = dimming	none off on previous
<i>Value to be sent after a recovery of the bus voltage.</i>		

6.3.3.12 Coupled: shutter or venetian blind

Parameter name	Conditions	Settings
Long press time	Channel x = coupled Type = shutter or venetian blind	hh:mm:ss.fff (00:00:03.000)
<i>Minimum push time for a press in order to be recognized as a long press.</i>		
xA and xB use	Channel x = coupled Type = shutter or venetian blind	A up, B down A down, B up
Blind mode	Channel x = coupled Type = shutter or venetian blind	enabled / disabled
<i>If blinds mode is enabled, the device sends "full movement" telegrams on long press and "step" telegrams on short press; if it is disabled, the device sends "full movement" telegrams on long press and "stop" telegrams on short press.</i>		
Lock function – Behaviour at locking	Channel x = coupled Type = shutter or venetian blind	none up down
<i>Allows to perform the specified operation when a locking command is received.</i>		
Lock function – Behaviour at unlocking	Channel x = coupled Type = shutter or venetian blind	none up down
<i>Allows to perform the specified operation when an unlocking command is received.</i>		
Value sent after bus on	Channel x = coupled Type = shutter or venetian blind	none up down
<i>Value to be sent after a recovery of the bus voltage.</i>		

For other communication objects related to *coupled* mode, please refer to the general *Channels Configuration* section.

7 Appendix

7.1 Communication objects table

Following is a summary of all KNX Communication Objects (CO) and corresponding Data Point Types (DPT) defined by the application program according to configuration options.

The listing order is generally by CO number (in case of COs repeated by channel, the CO number for the first channel is taken as relevant).

Object name	Conditions	Size	Flags	DPT	CO number(s)
Disable front pushbuttons	-	1 bit	C-W--	[1.002] false / true	0
Input xx / Channel x – Lock command	Channel x = Independent, <u>Channel A</u> Lock function = enabled	1 bit	C-W--	[1.003] enable	4, 42, 80, 118
	Channel x = coupled Lock function = enabled				
Input xx – Switching status [type] Object n*	Channel x = Independent, <u>Channel A</u> Type = send values or sequences	See table 1	CRWTU	See table 1	5..12, 43..50, 81...88, 119..126
	<p>* The listed CO numbers are starting from object nr.1; the COs for each subsequent object are following in sequence.</p> <p>To obtain the CO numbers for object number n, just add (n-1) to the listed numbers.</p> <p>E.g.: COs associated to input 3A (of Input 3) have numbers from 81 to 88. The number of CO nr. 5 is therefore $81+(5-1) = 85$.</p>				
Input xx / Channel x – Switching command	Channel x = Independent, <u>Channel A</u> Type = dimming	1 bit	CRWTU	[1.001] switch	13, 51, 89, 127
	Channel x = coupled Type = switch				
	Channel x = coupled Type = dimming				
Input xx / Channel x – Dedicated stop command	Channel x = Independent, <u>Channel A</u> Type = shutter or venetian blind	1 bit	CRWTU	[1.017] trigger	13, 51, 89, 127
	Channel x = coupled Type = shutter or venetian blind				
	Blind mode = disabled				

Input xx / Channel x – Dimming up / down / stop command	Channel x = Independent, <u>Channel A</u> Type = dimming	4 bit	CR-T-	[3.*] 3-bit control	14, 52, 90, 128
	Channel x = coupled Type = dimming				
Input xx / Channel x – Stop – step up/down command	Channel x = Independent, <u>Channel A</u> Type = shutter or venetian blind Blind mode = enabled	1 bit	CR-T-	[1.007] step	16, 54, 92, 130
	Channel x = coupled Type = shutter or venetian blind Blind mode = enabled				
Input xx / Channel x – Move up / down command	Channel x = Independent, <u>Channel A</u> Type = shutter or venetian blind	1 bit	CRWTU	[1.008] up/down	17, 55, 93, 131
	Channel x = coupled Type = shutter or venetian blind				
Input xx – Scene number	Channel x = Independent, <u>Channel A</u> Type = scene	1 Byte	CR-T-	[17.*] Scene number [18.*] Scene control	18, 61, 94, 132
Input xx – Counter value	Channel x = Independent, <u>Channel A</u> Type = counter	1 Byte 2 Bytes 4 Bytes	CR-T-	[12.001] Counter pulses [13.001] Counter pulses	18, 61, 94, 132
Input xx – Counter reset command	Channel x = Independent, <u>Channel A</u> Type = counter	1 bit	C-W--	[1.015] reset	19, 62, 95, 133
Input xx – Counter runout	Channel x = Independent, <u>Channel A</u> Type = counter	1 bit	C-W--	[1.055] alarm	20, 63, 96, 134
Input xx – Lock command	Channel x = Independent, <u>Channel B</u> Lock function = enabled	1 bit	C-W--	[1.003] enable	21, 64, 97, 135
Input xx – Switching status [type] Object n*	Channel x = Independent, <u>Channel B</u> Type = send values or sequences	See table 1	CRWTU	See table 1	22..29, 60..67, 98..105, 136..143
	<p>* The listed CO numbers are starting from object nr. 1; the COs for each subsequent object are following in sequence.</p> <p>To obtain the CO numbers for object number n, just add (n-1) to the listed numbers.</p> <p>E.g.: COs associated to input 3B (of Input 3) have numbers from 98 to 105. The number of CO nr. 5 is therefore 98+(5-1) = 102.</p>				

Input xx – Switching command	Channel x = Independent, <u>Channel B</u> Type = dimming	1 bit	CRWTU	[1.001] switch	30, 68, 106, 144
Input xx – Dedicated stop command	Channel x = Independent, <u>Channel B</u> Type = shutter or venetian blind	1 bit	CRWTU	[1.017] trigger	30, 68, 106, 144
Input xx – Dimming up / down / stop command	Channel x = Independent, <u>Channel B</u> Type = dimming	4 bit	CR-T-	[3.*] 3-bit control	31, 69, 107, 145
Input xx – Stop – step up/down command	Channel x = Independent, <u>Channel B</u> Type = shutter or venetian blind Blind mode = enabled	1 bit	CR-T-	[1.007] step	33, 71, 109, 147
Input xx – Move up / down command	Channel x = Independent, <u>Channel B</u> Function x = enabled Type = shutter or venetian blind	1 bit	CRWTU	[1.008] up/down	34, 72, 110, 148
Input xx – Scene number	Channel x = Independent, <u>Channel B</u> Type = scene	1 Byte	CR-T-	[17.*] Scene number [18.*] Scene control	35, 73, 111, 149
Input xx – Counter value	Channel x = Independent, <u>Channel B</u> Type = counter	1 Byte 2 Bytes 4 Bytes	CR-T-	[12.001] Counter pulses [13.001] Counter pulses	35, 73, 111, 149
Input xx – Counter reset command	Channel x = Independent, <u>Channel B</u> Type = counter	1 bit	C-W--	[1.015] reset	36, 74, 112, 150
Input xx – Counter runout	Channel x = Independent, <u>Channel B</u> Type = counter	1 bit	C-W--	[1.055] alarm	37, 75, 113, 151

Table 1. Independent/single channel object sizes and DPTs:

Size	DPT
1 bit	[1.001] switch
2 bits	[2.*] 1-bit controlled
1 byte unsigned	[4.*] character [5.*] 8-bit unsigned value [20.*] 1-byte
1 byte percentage	[4.*] character [5.*] 8-bit unsigned value [20.*] 1-byte
1 byte signed	[6.*] 8-bit signed value
2 bytes unsigned	[7.*] 2-byte unsigned value
2 bytes signed	[8.*] 2-byte signed value
2 bytes floating	[9.*] 2-byte float value

7.2 Warning

- Installation, electrical connection, configuration and commissioning of the device can only be carried out by qualified personnel
- Opening the housing of the device causes the immediate end of the warranty period
- ekinex® KNX defective devices must be returned to the manufacturer at the following address: SBS S.p.A. Via Novara 37, I-28010 Vaprio d'Agogna (NO) Italy

7.3 Other information

- This application manual is aimed at installers, system integrators and planners
- For further information on the product, please contact the ekinex® technical support at the e-mail address: support@ekinex.com or visit the website www.ekinex.com
- KNX® and ETS® are registered trademarks of KNX Association cvba, Brussels

© EKINEX S.p.A. The company reserves the right to make changes to this documentation without notice.